

THE CIRCUMSTANTIAL CASE FOR FLINT RIVER WATER AND HOT WATER TANKS LEADING TO FLINT'S LEGIONNAIRES' OUBREAK

Although the progressive community has been aware, for more than a year, of the water quality crisis in Flint that was created when the state-appointed emergency manager switched Flint from Detroit's water system to a supply from the nearby Flint River, national attention is only now starting to focus on it. Today's New York Times features an editorial denouncing the "depraved indifference" Governor Rick Snyder's administration showed toward Flint as the crisis unfolded.

The basics of what happened are clear. Water from the Flint River is much more corrosive than that from the Detroit water system (from Lake Huron). Even though this water leaves the Flint processing facility fairly clean and appearing to meet most standards, its corrosive nature results in the pipes in the aged Flint distribution system corroding. Both iron and lead leach into the water as a result of this corrosion, leaving the water with a reddish-orange tint and unsafe levels of lead. Children in the area have already shown elevated levels of lead in their systems. Sadly, lead damage is irreversible.

A bit of digging shows that the corrosive nature of the Flint River water comes from its high chloride content. [Note: free chloride ions (Cl^-) are distinct from intact molecular chlorine (Cl_2) and have very different chemical effects in the systems being described here. For brevity, they will be referred to as chloride and chlorine, respectively.] That high chloride

content very likely results from heavy application of salt to roads during winter and subsequent runoff of the salt into tributaries and the river. The Flint River has a chloride content about eight or nine times higher than Lake Huron.

Technical documentation of the Flint water crisis is almost entirely the work of a group of researchers directed by Professor Marc Edwards of the Department of Civil and Environmental Engineering at Virginia Tech (frequently updated at their website, flintwaterstudy.org). As the Times editorial noted, the Snyder administration tried to dismiss one group of critics as “anti-everything”. That won’t work with Edwards, who won a MacArthur Foundation Fellowship (often called a Genius Grant) in 2007 for his work on water quality.

One very simple and elegant study carried out by Edwards and his team is described in this post from August 24 of last year. The team took a clean-looking sample of Flint water and put it into a glass jar along with a piece of iron. The iron is present to mimic the effect of the Flint water coming into contact with iron pipes as it flows through the distribution system into people’s homes. An otherwise identical sample was prepared with water that came from the Detroit water system. After only five days, the jars looked dramatically different:




Figure 3: Higher release of iron is evident in the Flint water glass reactor containing iron than that with Detroit water

Flint water that has been in the presence of iron for five days takes on a reddish-orange cast while Detroit water does not. Image is Figure 3 found at <http://flintwaterstudy.org/2015/08/why-is-it-possible-that-flint-river-water-cannot-be-treated-to-meet-federal-standards/> by Dr. Marc A. Ewards and Siddhartha Roy.

The water in the Flint jar looks just like what we have seen in countless photos of exasperated Flint residents wanting something done about the poor quality of the water coming out of their taps. Leached iron by itself could well be the

cause of this discoloration that is common in Flint. We will come back to this same study in a bit.

In addition to the dire issue of unsafe lead levels in homes (and subsequently documented in children) that received Flint River water, another problem may relate to the changed water source. Writing at Huffington Post earlier this week, Erin Schumaker documented an outbreak of Legionnaires' Disease in Flint. Remarkably, in a graphic created by Alissa Scheller, we see that the outbreak coincides quite precisely with the change in water source:

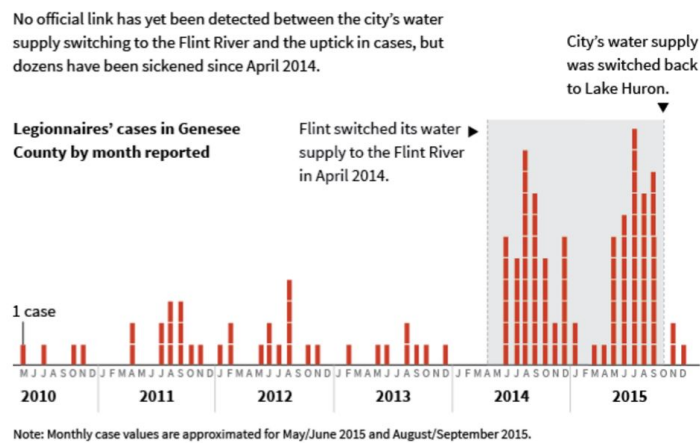

Huffington Post graphic depicting Legionnaires' Disease cases in Flint and their correlation with the water source. Link: http://www.huffingtonpost.com/entry/flint-water-legionnaires-lead-crisis_us_569d09d6e4b0ce4964252c33 Graphic by Alissa Scheller.

How could there be a pathway connecting the water source to a Legionnaires' outbreak? After all, the original outbreak for which the disease is named was the result of *Legionella* growing in the cooling tower for the air conditioning system of a large hotel. The victims then inhaled the bacteria as aerosols that migrated into the ventilation system from the cooling tower. Note that the "cooling tower" is actually quite hot and one of *Legionella's* distinctive characteristics is its love for elevated temperatures.

There is a further problem for how *Legionella* could have been in the water system. This study by the Edwards team showed that the standard test for bacterial contamination came up empty on Flint water. No coliform bacteria were found in Flint water collected at several sites, including from several homes.

This same study, however, found a huge warning sign. Although fecal bacterial contamination was not found, they found that many samples collected around town did not have any detectable levels of chlorine. Chlorine is needed in water systems to prevent growth of bacteria.

The August 24 study linked above went into further detail on this issue, where it was found that in the presence of iron, the corrosive nature of Flint water destroyed the chlorine that was present. This result leads to a very damning conclusion:

The high rates of iron corrosion from using Flint River water as a drinking water source are damaging the Flint distribution system. The corrosion is also causing chlorine to disappear quickly, which may make it more likely for harmful bacteria to grow in the water. Furthermore, it is possible that with the existing unlined iron pipe system in Flint, and the relatively low water demand (due to declining population, loss of GM – which used a lot of water – as a water customer, and high rates), that it will very difficult to meet Federal standards for minimum chlorine levels no matter what is done to treat the water.

So it turns out that although the Flint treatment plant treated the river water sufficiently to kill the coliform bacteria, once the water left the plant, its corrosive nature in iron pipes means that there would be no residual level of chlorine to retain

antimicrobial activity. This is especially bad in an aging water system, as the residual chlorine level would protect against low levels of bacteria introduced by failures in backflow control or small breaches in the system where surface or groundwater might be introduced into the system. In this same report, Edwards provides a link to reports of increased rates of water main leaks and breaks in Flint's aging system.

But when we move to consideration of *Legionella*, the situation gets much worse. Traditional water analysis for bacterial contamination, especially the fecal coliform test, would not reveal the presence of *Legionella*. The particularly difficult nature of culturing this bacterium led to prolonged confusion over the cause of the 1976 Philadelphia outbreak that gave the disease its name. So yes, *Legionella* likely would be eliminated just as the coliform bacteria were eliminated at the Flint treatment plant, but any *Legionella* introduced downstream could survive due to the low chlorine content. Further, *Legionella* would not be inactivated by the corrosive nature of the water. As for whether *Legionella* would be present in the region, consider that the disease Pontiac Fever (named for an outbreak in 1968) is also a *Legionella* infection that fortunately is less lethal. Pontiac is only 36 miles from Flint.

When we go to the literature on routes of *Legionella* infection, we have this from WHO (pdf):

The most common route of infection is the inhalation of aerosols containing the bacteria. Such aerosols can be generated by contaminated cooling towers, warm water showers, humidifiers and spas.

Warm water showers, huh? This gets even more interesting when we look at the temperature profile for *Legionella* survival and information on the proper setting for hot water tanks.

Consider this little nugget from energy.gov:

Although some manufacturers set water heater thermostats at 140°F, most households usually only require them to be set at 120°F, which also slows mineral buildup and corrosion in your water heater and pipes. Water heated at 140°F also poses a safety hazard—scalding.

Savings resulting from turning down your water heater temperature are based on two components: reduced standby losses (heat lost from water heater into surrounding basement area); and consumption (from water demand or use in your home). Set too high, or at 140°F, your water heater can waste anywhere from \$36 to \$61 annually in standby heat losses and more than \$400 in demand losses.

If you have a dishwasher without a booster heater, it may require a water temperature within a range of 130°F to 140°F for optimum cleaning. And while there is a very slight risk of promoting legionellae bacteria when hot water tanks are maintained at 120°F, this level is still considered safe for the majority of the population. If you have a suppressed immune system or chronic respiratory disease, you may consider keeping your hot water tank at 140°F. However, this high temperature significantly increases the risk of scalding.

And there we have it. A Flint home downstream of a discontinuity in the water system that introduces a small amount of *Legionella* would be at risk since the water would be likely to have insufficient chlorine to kill the *Legionella*. Further, if the household has its hot water tank thermostat set too low, the *Legionella* could thrive in the tank and then infect an immune

compromised individual who inhales aerosols of the bacteria while showering.

Update 9 pm Friday Evening

MILive is now reporting that *Legionella* was found in the water supply of a Flint hospital in 2014, after the switch in the supply:

“After the City of Flint switched to the Flint River as its water source in April of 2014, we noticed an increase in the number of Legionella cases that were coming to McLaren for treatment, as well as those being reported across the county and at other hospitals,” McLaren spokeswoman, Laurie Prochazka said.

“Because of that concern, and concern over the quality of water that we were receiving from the city, we began aggressively testing our water supply. An early test result indicated the presence of a low level Legionella.”